





80.01

	80.01.0.240.0000 U _N (12...240) V AC (50/60 Hz)/DC U _{min} 10.8 V AC/DC U _{max} 265 V AC/DC P < 1.8 VA (50 Hz) / < 1 W
	1 CO (SPDT) 16 A 250 V AC
	AC1 4000 VA AC15 (230 V AC) 750 VA
	M (230 V AC) 0.55 kW
	DC1 (24/110/220) V (16/0.3/0.12) A
	(-20...+60)°C
IP20	

LED	U _N		
	-	15 - 18	15 - 16
	✓	15 - 18	15 - 16
	✓		15 - 16
	✓	15 - 16	15 - 18



- Open Type Device
- Pollution degree 2 Installation Environment
- Maximum Surrounding Air Temperature 40°C
- Use 60/75°C copper (Cu) conductor only and wire ranges No. 14-18 AWG, stranded or solid
- Terminal tightening torque of 7.1 lb.in. (0.8 Nm)

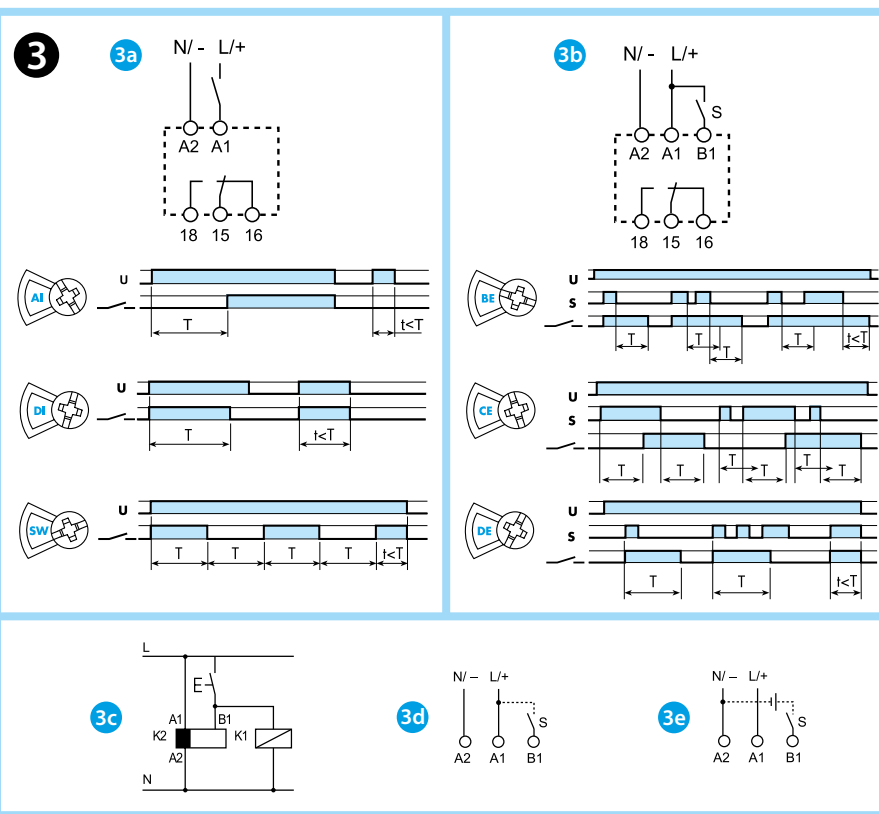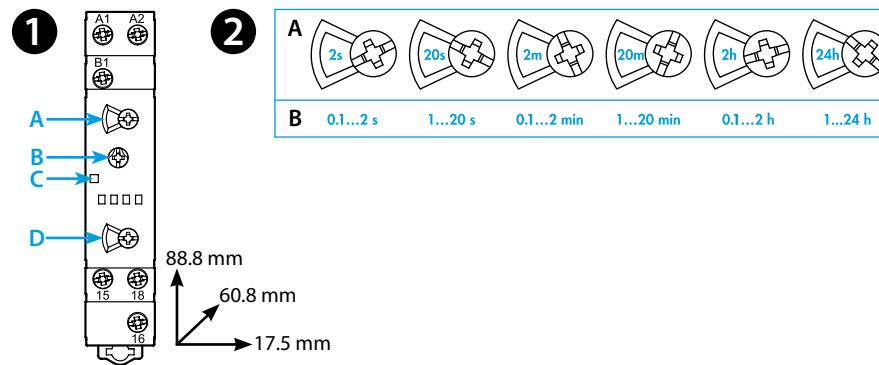

ENGLISH

80.01 MODULAR TIMER, MULTI-FUNCTION

1 FRONT VIEW

- A Time scale rotary selector (Tmax)
- B Time setting (Tmin...Tmax)
- C LED
- D Function rotary selector

2 TIME SCALES

(Eg. T=10 min: set A=20 m and B=10)

3 WIRING DIAGRAM AND FUNCTIONS

NOTE

Time scale and function must be set before energising the timer

3a Without signal START functions:

Start via contact in supply line (A1)

AI On-delay

DI Interval

SW Symmetrical flasher (starting pulse on)

3b External START functions: Start via contact into control terminal (B1)

BE Off-delay with control signal

CE On- and off-delay with control signal

DE Interval with control signal on

3c Possible to control an external load, such as another relay coil or timer, connected to the signal start terminal B1

3d With DC supply, positive polarity has to be connected to B1 terminal (according to EN 60204-1)

3e A voltage other than the supply voltage can be applied to the command Start (B1), example:

A1-A2 = 230 V AC

B1-A2 = 12 V DC

OTHER DATA

Minimum control impulse: 50 ms

Recovery time: 100 ms

35 mm rail mount (EN 60715)

WORKING CONDITIONS

In accordance with the European EMC Directive 2014/30/EU, the timer has a high level of immunity against both radiated and conducted disturbances, considerably exceeding the requirements of EN 61812-1. However, devices such as transformers, motors, contactors, switches and power cables may cause disturbances and even damage the timer's electronic circuit. It is therefore recommended that the wiring cables are as short as possible, and when necessary, that the system is protected by Finder 7P Series surge protection devices.