



SGS

EC Type Examination Certificate Number: **0120/ SGS0108**

Zhejiang YongTailLong (YTL) Electronic Co., Ltd

No. 8, Kangding Road
Tongxiang
Zhejiang
China

Instrument Identification:
DTS353

Poly Phase, Active Import/Export, Electricity Meter

Instrument Traceable Number
0120/ SGS0108

has been assessed and certified as meeting the requirements of

EC Directive 2004/22/EC

on Measuring Instruments Annex B

It is certified that the manufacturer's technical design and specimen for the above instrument has been examined and, based on the evidence submitted, it is considered that the instrument conforms to the requirements of MI-003 of EC Directive 2004/22/EC

This certificate must be used in conjunction with a certificate covering the product verification as required in Annex D or Annex F.

This certificate is valid for 10 years from 27th November 2012 until 26th November 2022
Issue 2

Certification is based on report number(s)
SHES1207001819MI Issued 27th November 2012

Authorised Signature

Jan Saunders

SGS United Kingdom Limited, Notified Body 0120
Unit 202B Worle Parkway, Weston-super-Mare, BS22 6WA UK
t +44 (0)1934 522917 f +44 (0)1934 522137 www.sgs.com

Contact Address
SGS United Kingdom Ltd, Unit 10, South Industrial Estate, Bowburn, Durham, DH6 5AD UK
t +44 (0)191 377 2000 f +44 (0)191 377 2020 www.sgs.com

This document is issued, on the Client's behalf, by the Company under its General Conditions of Service printed overleaf.
The Client's attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein.

Any other holder of this document is advised that information contained herein reflects the Company's findings at the time of its intervention only and within the limits of Clients instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents.

MID-B06E Rev 5

Page 1 of 6

EC Type Examination Cert.
SGSPAPER
11999541





	EC-Type Examination Certificate Number:	
	0120/ SGS0108	
	Issue Number: 2	Dated: 27 th November 2012

1. Technical Data

Manufacturer	YTL
Meter Type	DTS353
Voltage Rating (U_n)	3x230/400V
Current Rating ($I_{min} - I_{ref} (I_{max})$)	0,25-5(100)A
Frequency (F_n)	50Hz
Active Accuracy Class (kWh)	A or B (kWh)
Type of circuit	3p4w
Temperature Range	-25°C to +55°C
Software/ Firmware Version No Identification Location	V1.0 Nameplate
Bill Of Materials Number	DTS353 BOM Rev 1
IP Rating	IP51
Insulation Protective Class	Class II
LED Pulse Constant	1000 imp/ kWh
Impulse Voltage Rating	6kV
AC Voltage Rating	4kV
Main Cover Sealing Type	Wire & Crimp
Integrity of meter	Inaccessible without breaking seals
Intended Location of the Meter	Indoor
Type of Register	LCD
Terminal Arrangement(s)	BS

	EC-Type Examination Certificate Number:	
	0120/ SGS0108	
	Issue Number: 2	Dated: 27 th November 2012

2. Photograph of Meter and Sealing Plan

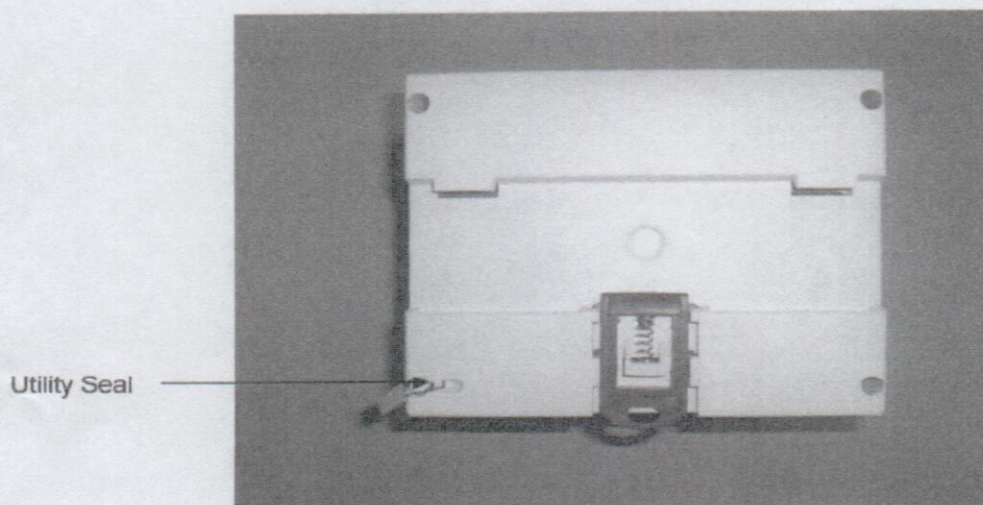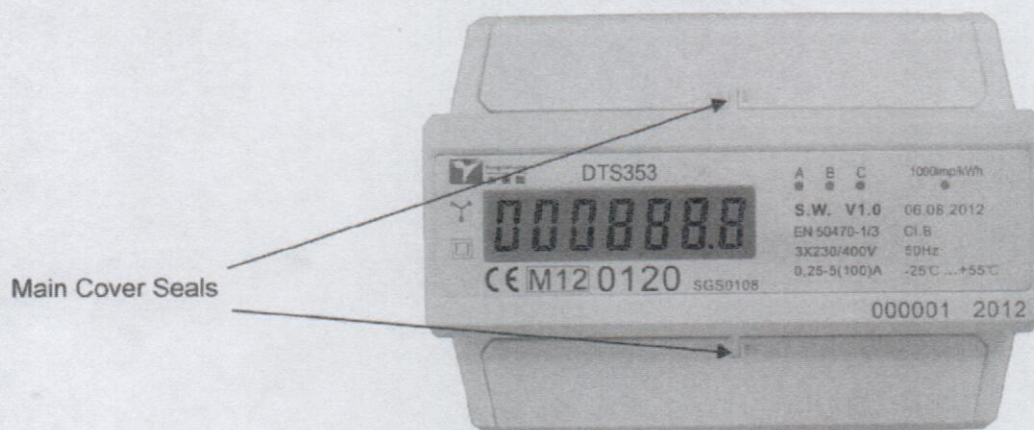



EC-Type Examination Certificate Number:

0120/ SGS0108

Issue Number: 2

Dated: 27th November 2012

3. Calculation of the composite error/ MPE

During the type approval examination the influence factors for temperature, frequency and voltage are determined per load point. The table below presents the sum of the square values per load, determined via the following formula:-

$$\delta e(T, U, f) = \sqrt{(\delta e^2(T, I, \cos\phi) + \delta e^2(U, I, \cos\phi) + \delta e^2(f, I, \cos\phi))}$$

where

$\delta e(T, I, \cos\phi) =$ Additional error due to variation of the temperature at the same load

$\delta e(U, I, \cos\phi) =$ Additional error due to variation of the voltage at the same load

$\delta e(f, I, \cos\phi) =$ Additional error due to variation of the frequency at the same load

Current	PF Cos	e(U/cos)	e(f/cos)	-25°C	-10°C	5°C	30°C	40°C	55°C
				%MPE	%MPE	%MPE	%MPE	%MPE	%MPE
I _{min}	1.0	0.01	-0.10	0.33	0.31	0.16	0.04	0.03	0.04
I _{tr}	1.0	-0.08	-0.17	0.26	0.24	0.14	0.06	0.05	0.06
10I _{tr}	1.0	0.06	0.07	0.25	0.19	0.07	0.05	0.08	0.18
I _{max}	1.0	-0.05	-0.08	0.41	0.30	0.21	0.15	0.16	0.22
I _{tr}	0.5ind	0.01	0.02	0.33	0.25	0.22	0.16	0.23	0.20
10I _{tr}	0.5ind	-0.01	0.11	0.32	0.25	0.17	0.14	0.18	0.28
I _{max}	0.5ind	-0.04	-0.11	0.53	0.44	0.37	0.33	0.35	0.40
I _{tr}	0.8cap	0.06	0.07	0.33	0.23	0.07	0.07	0.06	0.08
10I _{tr}	0.8cap	-0.01	0.04	0.22	0.15	0.07	0.04	0.07	0.16
I _{max}	0.8cap	-0.03	-0.04	0.34	0.23	0.13	0.06	0.09	0.17



EC-Type Examination Certificate Number:

0120/ SGS0108

Issue Number: 2

Dated: 27th November 2012

Current	PF Cos	e(Ulcos)	e(flc _{os})	-25°C	-10°C	5°C	30°C	40°C	55°C
				%MPE	%MPE	%MPE	%MPE	%MPE	%MPE
Line 1									
ltr	1.0	0.04	0.12	0.54	0.53	0.21	0.15	0.15	0.27
10ltr	1.0	-0.05	-0.07	0.53	0.36	0.19	0.06	0.14	0.26
lmax	1.0	-0.05	-0.09	0.59	0.40	0.22	0.04	0.11	0.26
ltr	0.5ind	-0.11	-0.27	0.56	0.26	0.23	0.04	0.15	0.32
10ltr	0.5ind	0.04	0.13	0.53	0.36	0.14	0.11	0.20	0.34
lmax	0.5ind	-0.04	-0.13	0.68	0.51	0.34	0.23	0.27	0.38
Line 2									
ltr	1.0	-0.13	-0.12	0.16	0.12	0.16	0.04	0.05	0.05
10ltr	1.0	0.02	0.08	0.10	0.08	0.08	0.08	0.08	0.09
lmax	1.0	-0.05	-0.06	0.16	0.10	0.05	0.01	0.02	0.07
ltr	0.5ind	-0.09	0.29	0.27	0.05	0.18	0.03	0.15	0.05
10ltr	0.5ind	-0.06	-0.13	0.07	0.09	0.03	0.02	0.05	0.06
lmax	0.5ind	-0.06	-0.12	0.23	0.18	0.13	0.10	0.11	0.13
Line 3									
ltr	1.0	0.14	-0.09	0.26	0.16	0.14	0.10	0.14	0.11
10ltr	1.0	0.04	0.07	0.25	0.18	0.14	0.14	0.17	0.25
lmax	1.0	-0.02	-0.06	0.34	0.23	0.12	0.02	0.09	0.19
ltr	0.5ind	-0.25	0.07	0.35	0.36	0.21	0.09	0.07	0.12
10ltr	0.5ind	0.05	0.12	0.27	0.22	0.13	0.09	0.17	0.25
lmax	0.5ind	-0.04	-0.11	0.45	0.32	0.33	0.15	0.19	0.28

	EC-Type Examination Certificate Number:	
	0120/ SGS0108	
	Issue Number: 2	Dated: 27 th November 2012

4. Annex of Variants

Product Variant Identification Details:

Type Designation	Description of meter
DTS353	0,25-5(100)A - Poly Phase, Active Import/Export, Electricity Meter

Modifications to the meter(s) described according to approval No.**0120/ SGS0108** must be notified to the issuing body to confirm the meter(s) continuing compliance to the relevant pattern approval standard(s).

5. Document Revision History

Issue	Date	Comments
1	27/11/2012	Initial Issue
2	7/12/2012	Photograph of markings updated